


## 2024 WATER USE EFFICIENCY (WUE) GOALS GROUP 'A' COMPANYWIDE PROGRESS REPORT



### 2024 Distribution System Leakage (DSL) Systems Exceeding 10%

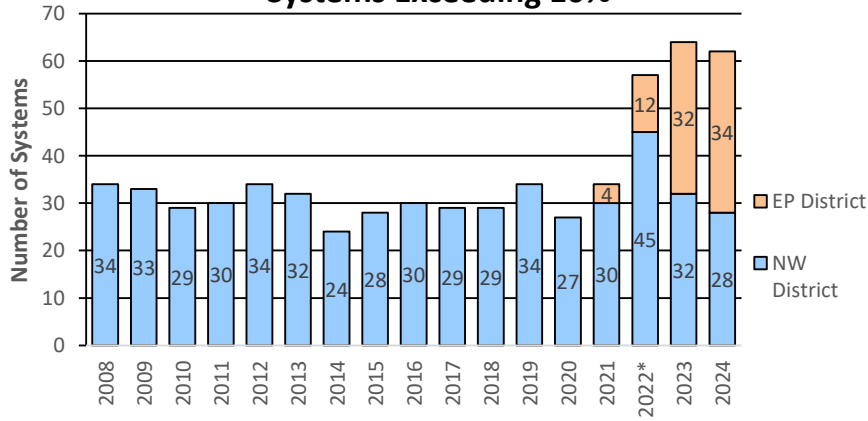

### Total Number of Systems Washington Water Owns and Manages

219 Group 'A' & 'B', Owned and Managed

### Systems Evaluated for WUE


125 Total Group 'A' Owned

77 NW District Group 'A' Owned

48 EP District Group 'A' Owned

\*In 2022, WWS redefined Operating Districts for geographical efficiencies.


### 2024 Source of Customer Demand Systems Exceeding 0.36 AF/ERU

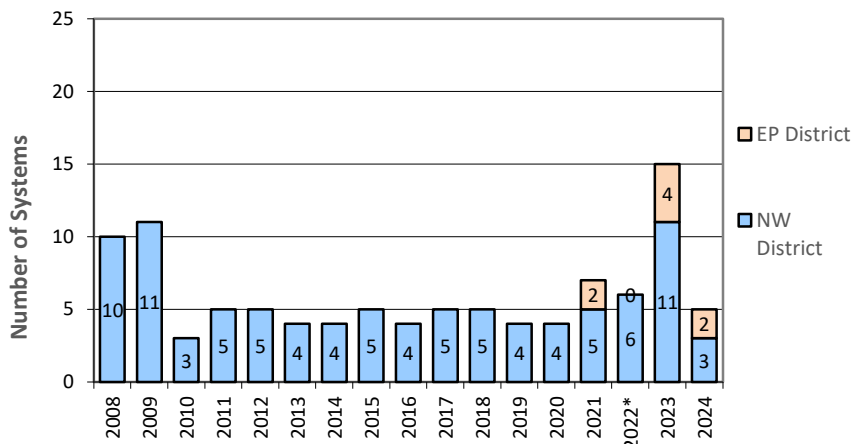

### Goal Achievement Priorities

- First      Prioritize and fix systems with DSL over 10%
- Second    Prioritize and fix systems with Source of Supply Demand in excess of 0.40 AF/ERU
- Third      Prioritize and fix systems with Customer Demand in excess of 0.36 AF/ERU
- Lastly     After companywide goals have been achieved, set system specific WUE goals.

### 2024 Source of Supply Systems Exceeding 0.40 AF/ERU

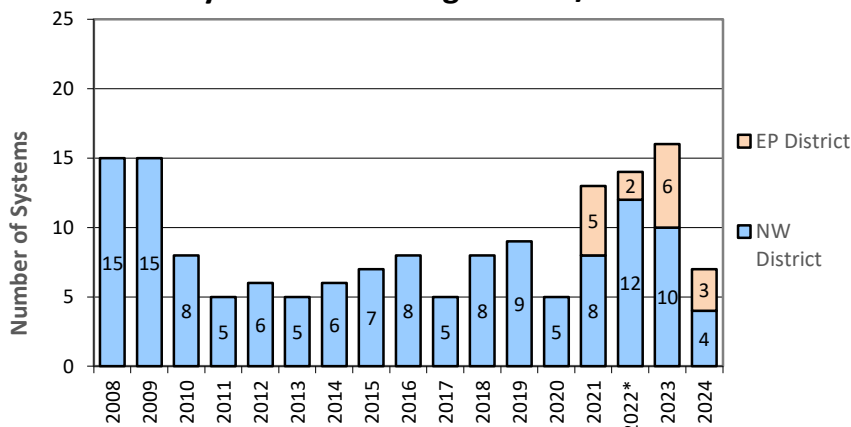

### Definitions

Group 'A'      15 or more connections or 25 or more population count

AF              Acre-Feet

ERU            Typical residential connection