

2025 WATER USE EFFICIENCY (WUE) GOALS GROUP 'A' COMPANYWIDE PROGRESS REPORT



Total Number of Systems Washington Water Owns and Manages

220 Group 'A' & 'B', Owned and Managed
Systems Evaluated for WUE
 126 Total Group 'A' Owned
 80 NW District Group 'A' Owned
 46 EP District Group 'A' Owned

*In 2020, WWS acquired Rainier View Water Company.
 **In 2022, WWS redefined Operating Districts for geographical efficiencies.

Goal Achievement Priorities

- First Prioritize and fix systems with DSL over 10%

- Second Prioritize and fix systems with Source of Supply Demand in excess of 0.40 AF/ERU

- Third Prioritize and fix systems with Customer Demand in excess of 0.36 AF/ERU

- Lastly After companywide goals have been achieved, set system specific WUE goals.


Definitions

Group 'A' 15 or more connections or 25 or more population count


AF Acre-Feet

ERU Typical residential connection

2025 Distribution System Leakage (DSL) Systems Exceeding 10%

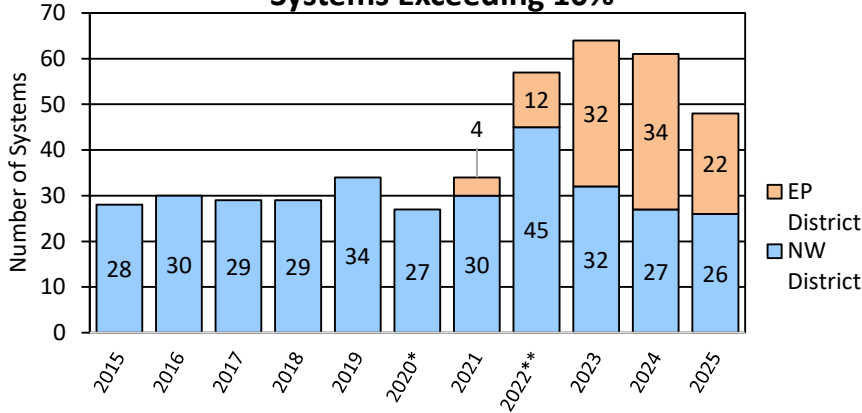

2025 Source of Customer Demand Systems Exceeding 0.36 AF/ERU

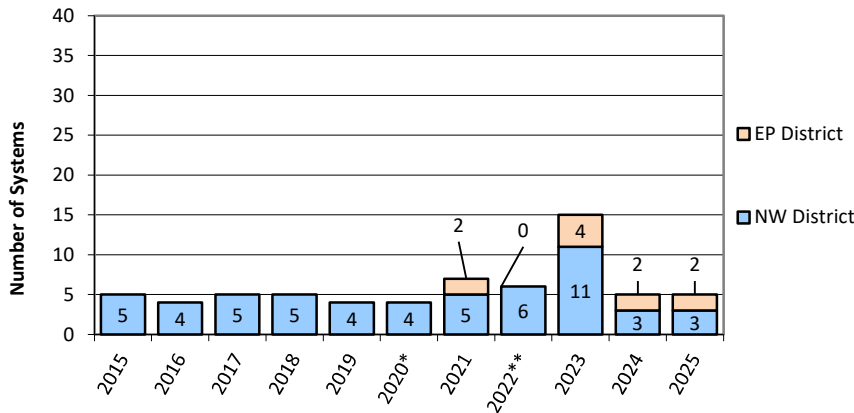

2025 Source of Supply Systems Exceeding 0.40 AF/ERU

